REVISION No. 9

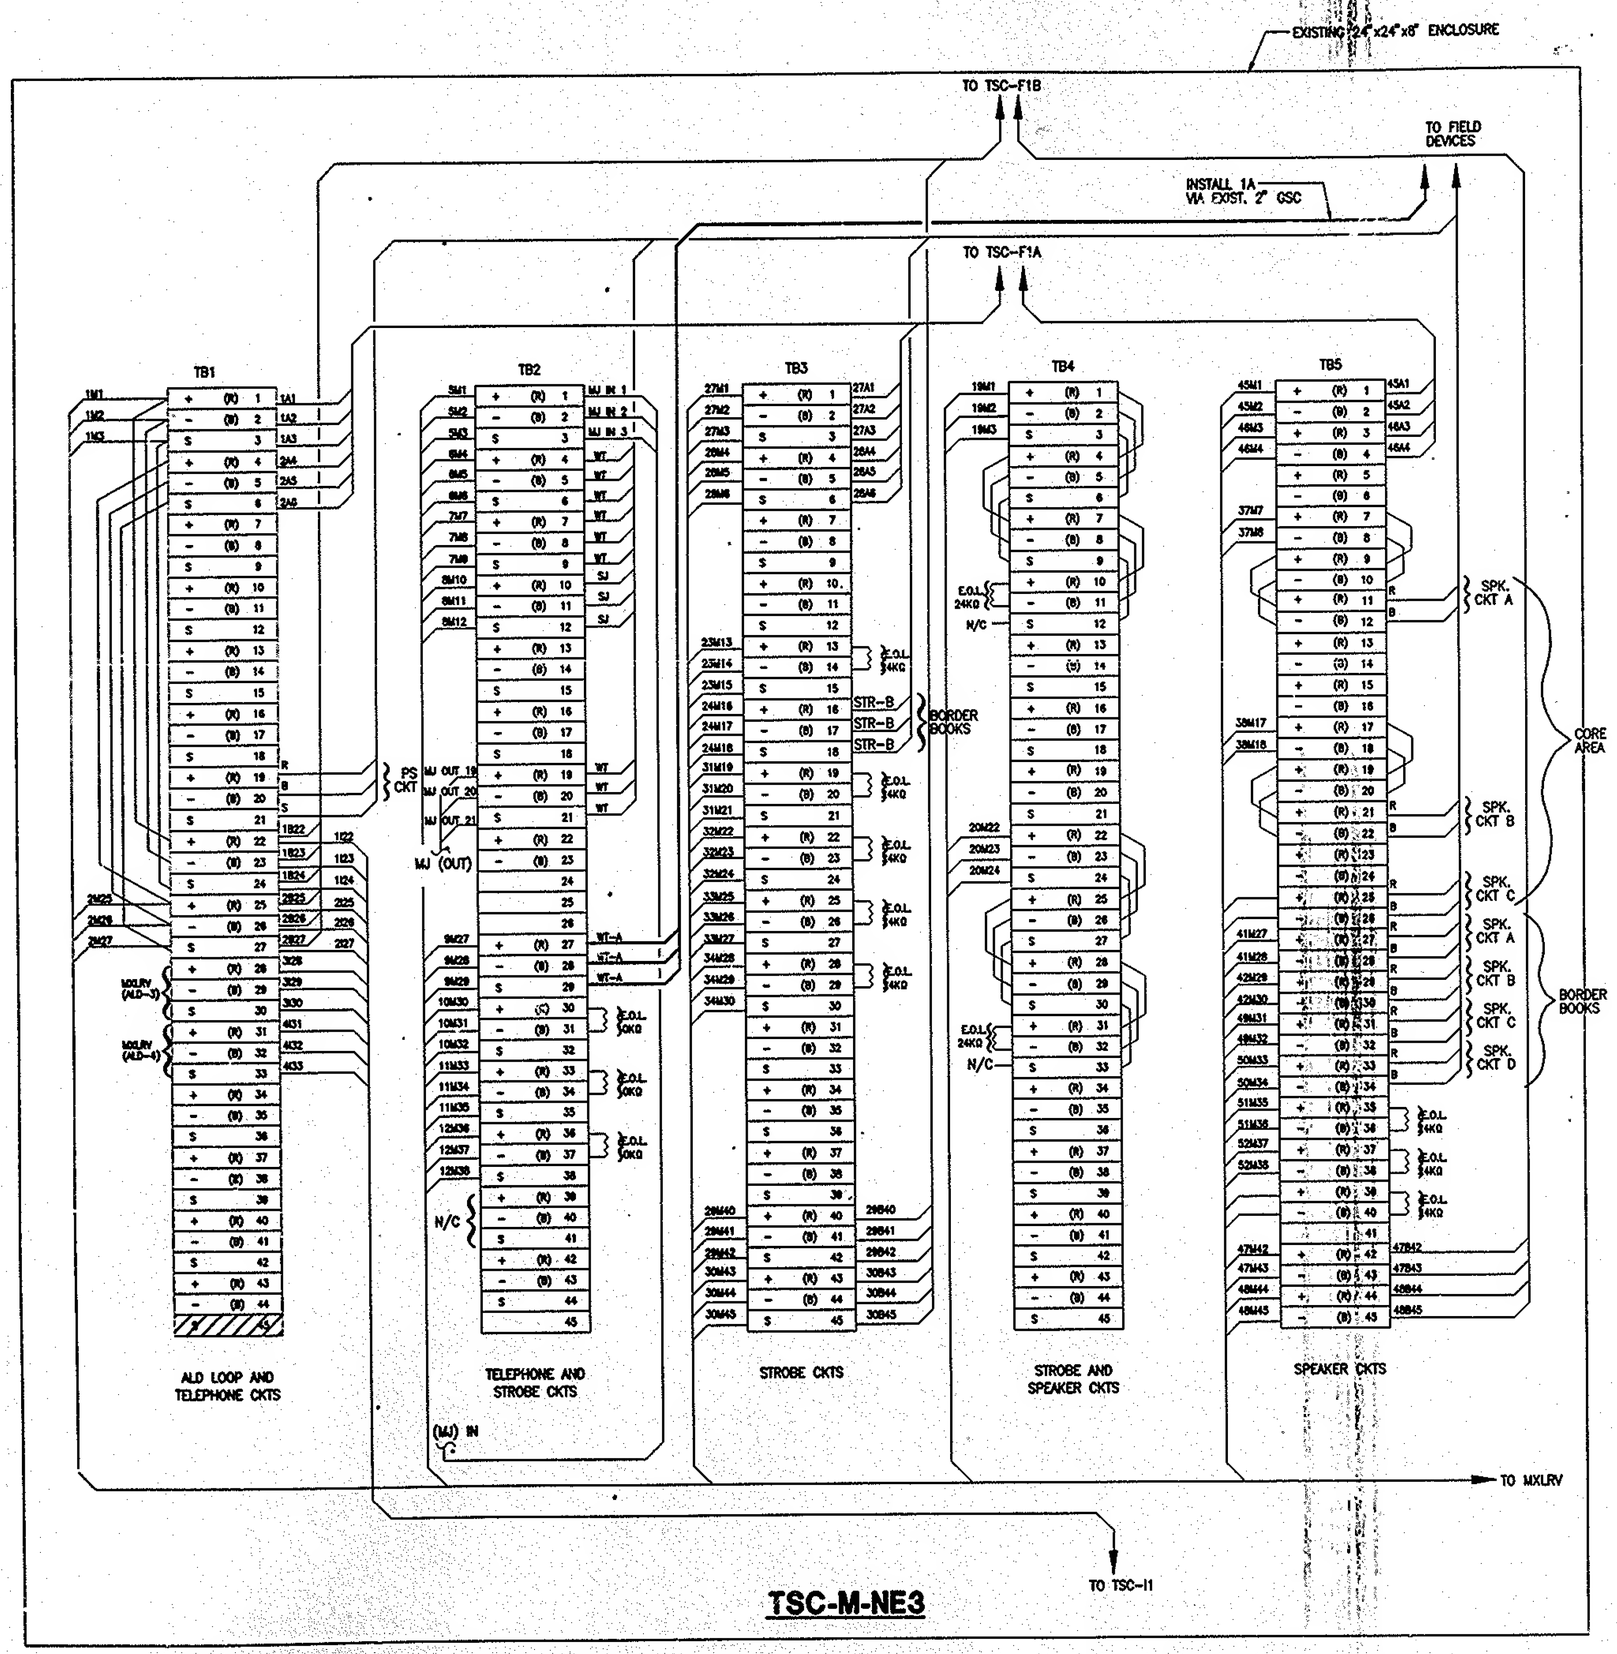

TSC-M-NE3

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL
2. ALL SHIELDS MUST BE ISOLATED FROM G TUBING SHALL BE USED ON ALL DRAIN C (ON THIS DWG).
3. ALL WIRING SHALL BE FREE OF GROUND STRAY VOLTAGES.
4. CONTRACTOR SHALL SHAPE, TEST AND LA CONNECTION SHALL BE MADE BY CONTRA AND UNDER THE DIRECT SUPERVISION OF
5. FOR TSC-M-NE3 ENCLOSURE LOCATION, MER PLAN.

LEGEND:

23M13

#14 AWG CONDUCT
23 - INDICATES
M - INDICATES
13 - INDICATES
I - INDICATES
A - INDICATES
B - INDICATES

TB2 - TERMINAL

+ (R) 2

(+) INDICATE
(-) INDICATE
(R) INDICATE
(B) INDICATE
(S) INDICATE
2 INDICATE

UNUSED

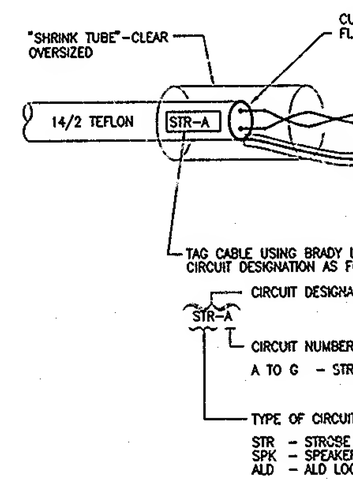

DETAIL "A" - TYPICAL SHIELD/D

FILE NAME: Y:\Wc-861.571\SWTC\E-24.dwg plotted on 5/6/1999 by BROYZMAN